




1-800-248-0280
831 Morley Drive
Saginaw, MI 48601

DETAIL E2095

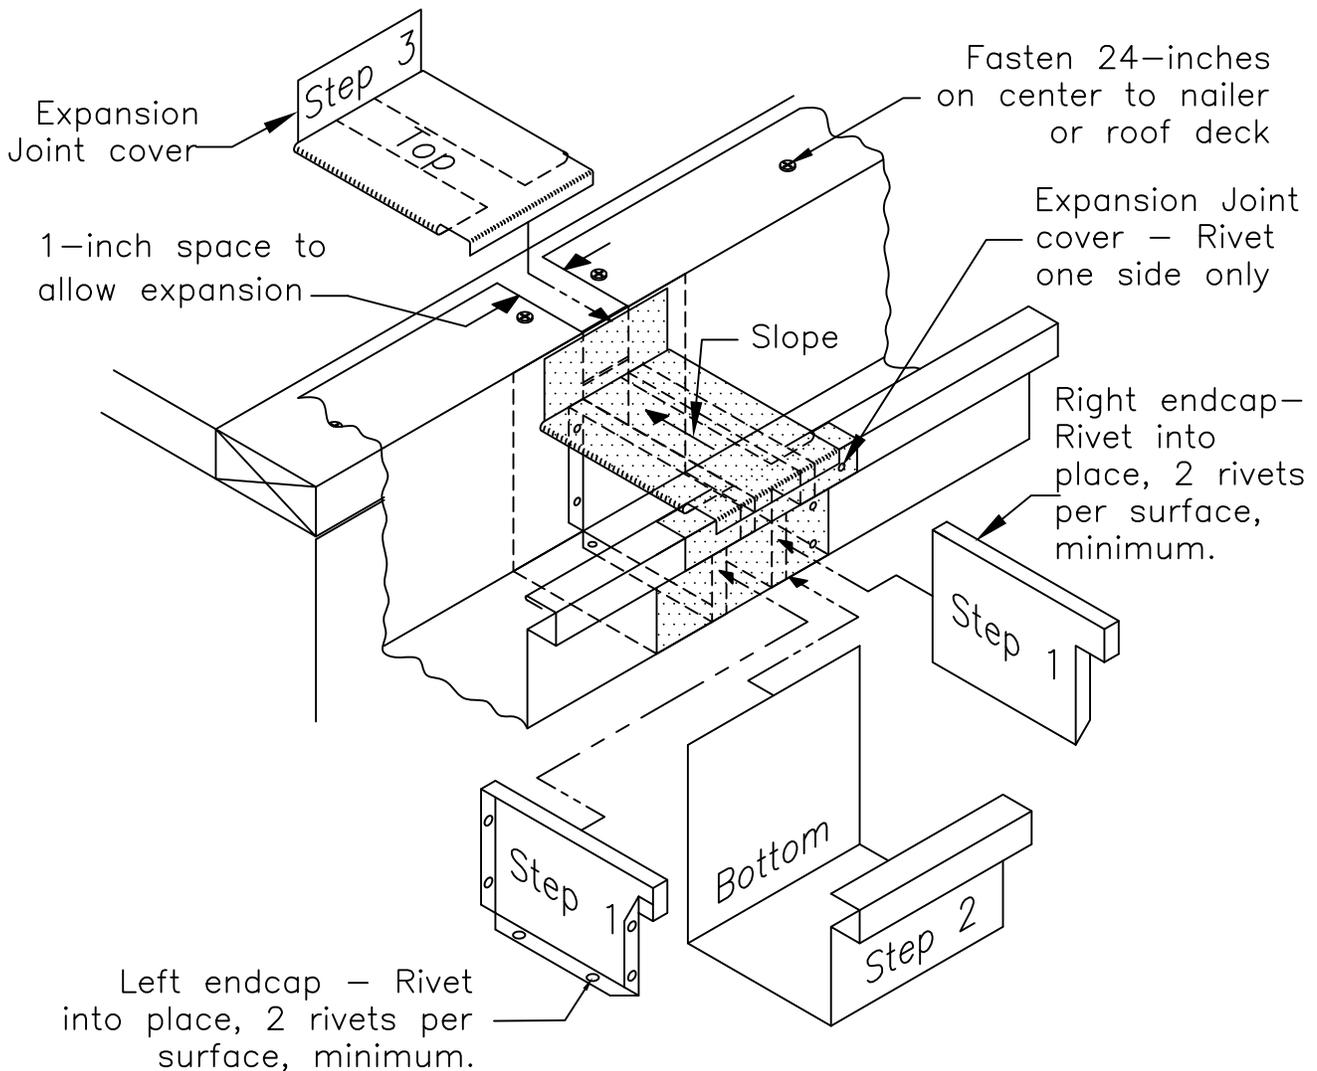

NOTE 1: Endcaps are to be riveted into position. On Expansion Joint cover rivet one side of the joint only.

NOTE 2: All joints, splices, corners, and endcaps must have approved sealant applied to them to ensure a watertight application.

NOTE 3: One Expansion Joint should be installed for every 40-50 feet of gutter being installed. Allow for a 1-inch space between expansion areas.

NOTE 4: Gutter straps are required every 24 to 30-inches on center.

NOTE 5: Drainage slope and drain sizes are to be determined by local building code requirements and are the responsibility of the contractor to follow.

DATE: JANUARY 2013

DRAINAGE DETAILS

DRAWN BY: ENG. DEPT.

GUTTER EXPANSION JOINT

SCALE: NONE

NEW CONSTRUCTION OR RE-ROOF